ClimaCon F 90 230 V (1155009)

nur Heizen, mit Regudis W-HTE und Anschlussleiste mit Timer, mit Pumpenlogik, Absenken als Slave-Raumthermostat

heating only, with Regudis W-HTE and connecting block with time switch, with pump logic, setback as follower room thermostat

oventrop

Schema zum elektrischen Anschluss
Diagram for the electrical connection
ClimaCon F

Art.-Nr.-ID *Art. No.-ID*
1155009-33A

Projekt *Project*
ovt22025

Stand *Revision*
26.10.2022

Maßstab *Scale*
–

Farben *Colors*
IEC 60757

BK Schwarz *Black*
BN Braun *Brown*
BU Blau *Blue*
GN Grün *Green*
GY Grau *Grey*
PK Rosa *Pink*
RD Rot *Red*
VI Violett *Violet*
YE Gelb *Yellow*
GNYE Grün-Gelb *Green-Yellow*

Es müssen die gültigen Installationsrichtlinien sowie die anerkannten Regeln der Technik beachtet werden. Nicht alle Komponenten der Anlage sind vollständig abgebildet. Das Schema ersetzt keine Detailplanung. Die Anleitungen der einzelnen Komponenten sind zu beachten. Alle Angaben und Ergebnisse sind bauseits zu prüfen.

The valid installation guidelines and the recognised rules of technology must be observed. Not all components of the system are shown in full. The diagram does not replace detailed planning. The instructions for the individual components must be observed. All information and results must be checked on site.

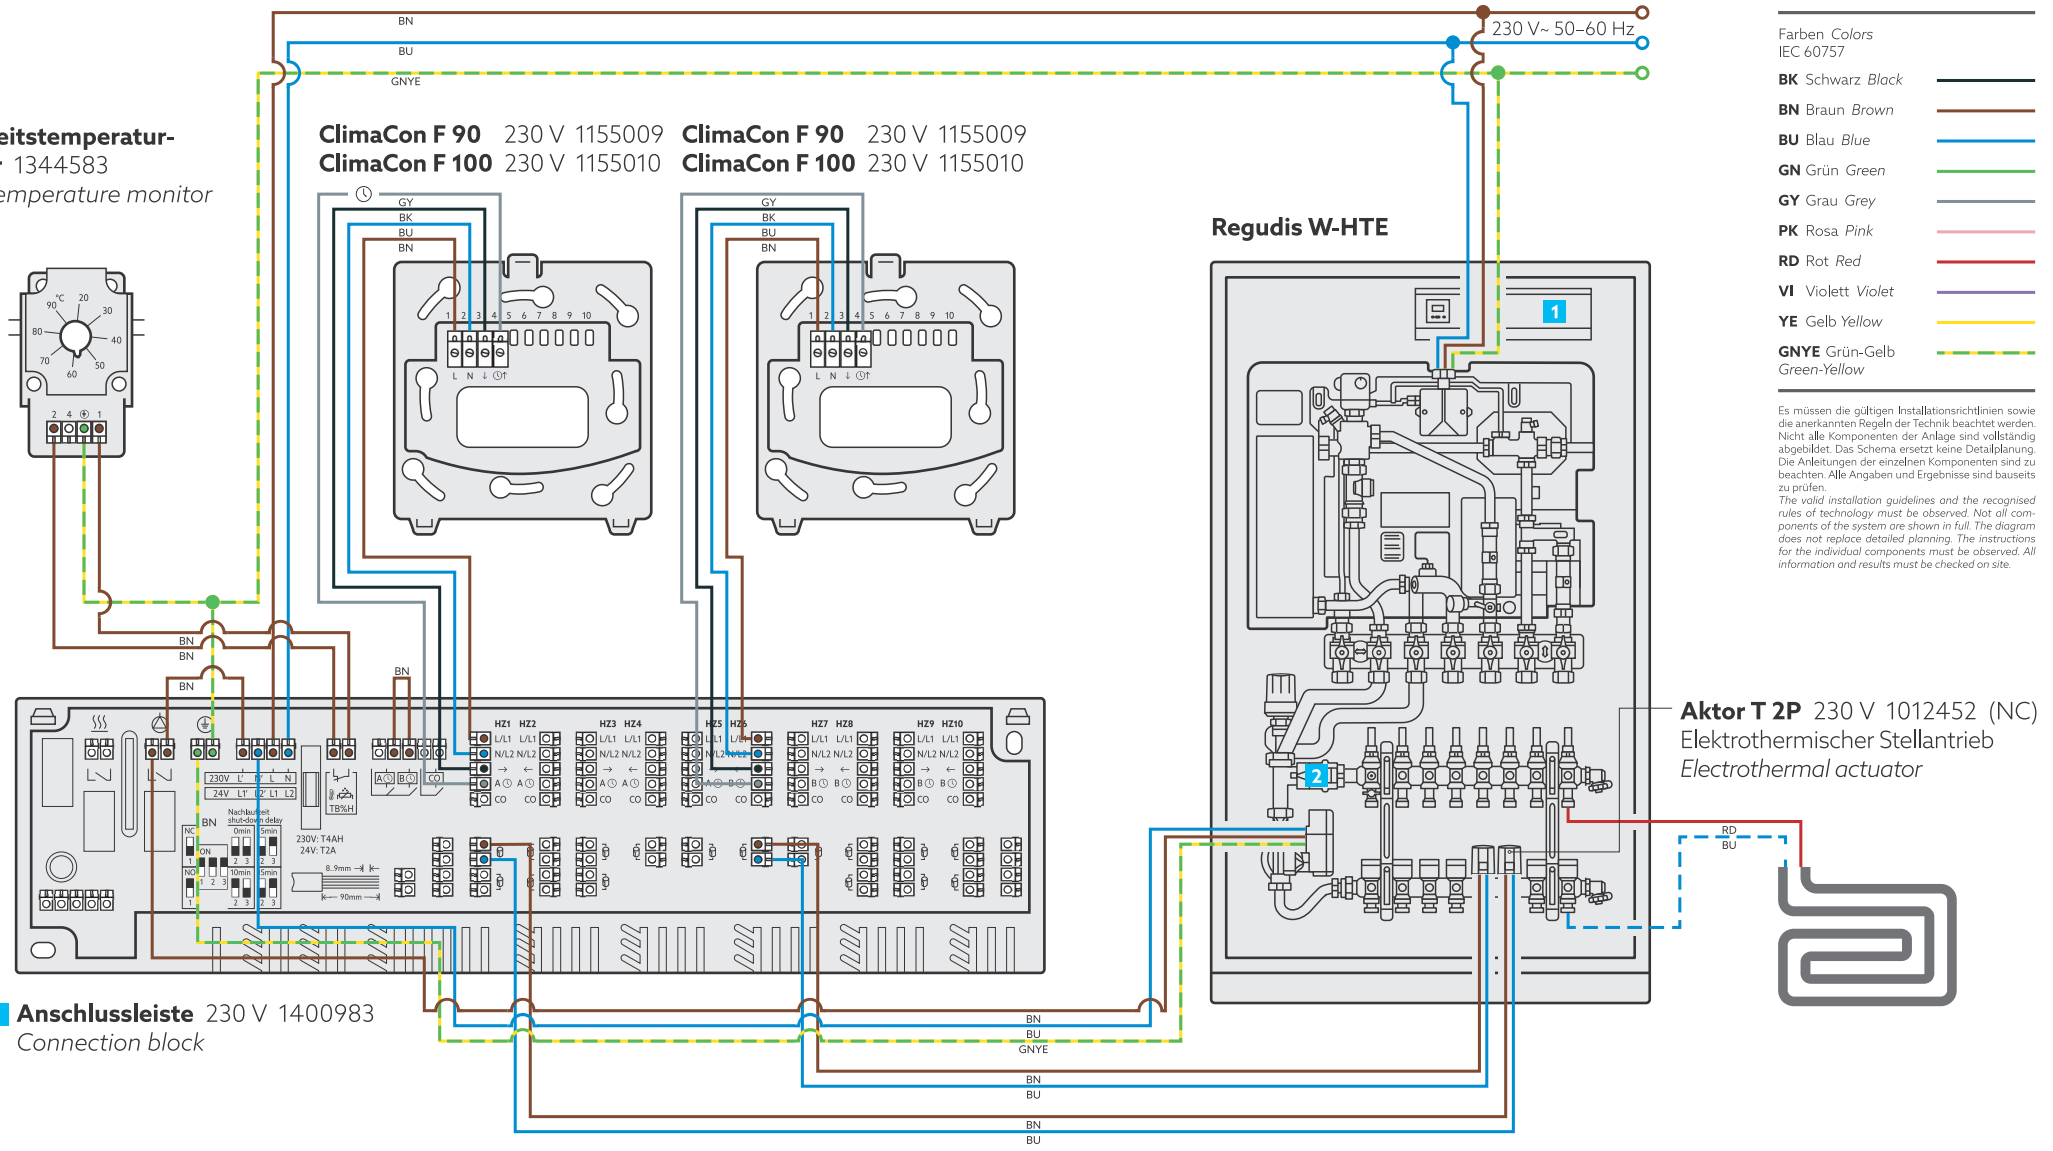

2 Sicherheitstemperatur-wächter 1344583
Safety temperature monitor

Aktor T 2P 230 V 1012452 (NC)
Elektrothermischer Stellantrieb
Electrothermal actuator

1 Anschlussleiste 230 V 1400983
Connection block