ClimaCon F 90 230 V (1155009)

nur Heizen/nur Kühlen (ohne C/O), Absenken als Slave-Raumthermostat

heating only/cooling only (without c/o), setback as follower room thermostat

oventrop

Schema zum elektrischen Anschluss
Diagram for the electrical connection
ClimaCon F

Art.-Nr.-ID *Art. No.-ID*	Projekt *Project*
1155009-04	**ovt22025**

Stand *Revision*	Maßstab *Scale*
26.10.2022	–

Farben *Colors*
IEC 60757

BK Schwarz *Black*
BN Braun *Brown*
BU Blau *Blue*
GN Grün *Green*
GY Grau *Grey*
PK Rosa *Pink*
RD Rot *Red*
VI Violett *Violet*
YE Gelb *Yellow*
GNYE Grün-Gelb *Green-Yellow*

Es müssen die gültigen Installationsrichtlinien sowie die anerkannten Regeln der Technik beachtet werden. Nicht alle Komponenten der Anlage sind vollständig abgebildet. Das Schema ersetzt keine Detailplanung. Die Anleitungen der einzelnen Komponenten sind zu beachten. Alle Angaben und Ergebnisse sind bauseits zu prüfen.
The valid installation guidelines and the recognised rules of technology must be observed. Not all components of the system are shown in full. The diagram does not replace detailed planning. The instructions for the individual components must be observed. All information and results must be checked on site.

MASTER
ClimaCon F 210 230 V 1155021
ClimaCon F 310 230 V 1155031

SLAVE
ClimaCon F 90 230 V 1155009

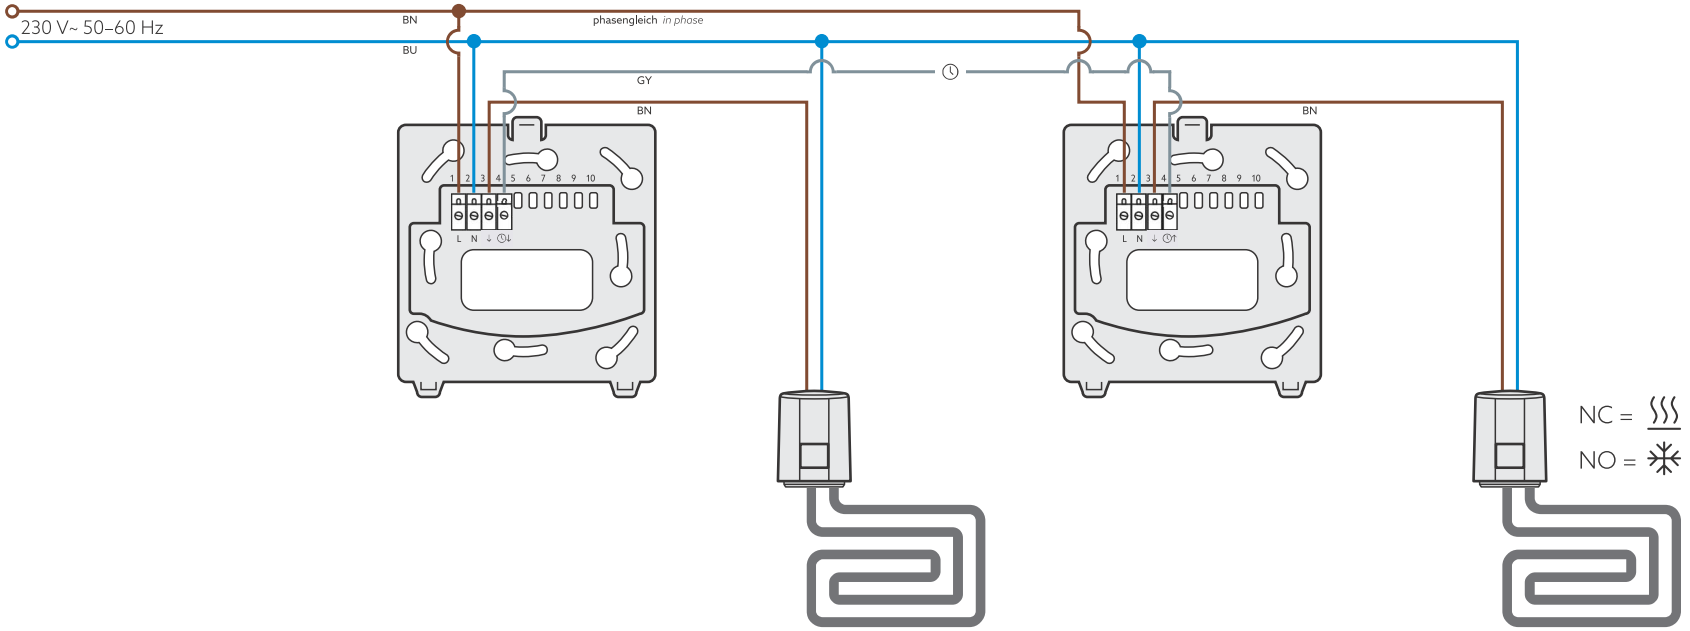

Aktor T 2P 230 V
Elektrothermischer Stellantrieb
Electrothermal actuator