

# CONTROL UNIT GUIDE

---

# Oventrop REGTRONIC PM

## **Important!**





Please read the instructions carefully before installing and operating the unit!

Failure to do this can void product warranty!  
Please keep the instructions in a safe place!

This unit described has been manufactured and inspected according to CE regulations.

**Table of Contents:**

<b>1</b>	<b>GENERAL / INTRODUCTION</b> .....	<b>3</b>
<b>2</b>	<b>GENERAL PRINCIPLES:</b> .....	<b>4</b>
<b>3</b>	<b>GENERAL CONTROL FUNCTIONS</b> .....	<b>4</b>
3.1	COLLECTOR PROTECTION FUNCTION .....	4
3.1.1	<i>In/outputs</i> .....	4
3.1.2	<i>Data input / parameters</i> .....	4
3.2	SYSTEM PROTECTION FUNCTION .....	5
3.2.1	<i>In/outputs</i> .....	5
3.2.2	<i>Data input / parameters</i> .....	5
3.3	ANTI-FREEZE PROTECTION FUNCTION.....	5
3.3.1	<i>In/outputs</i> .....	5
3.3.2	<i>Data input / parameters</i> .....	5
3.4	PUMP PROTECTION FUNCTION.....	6
3.4.1	<i>In/outputs</i> .....	6
3.4.2	<i>Data input / parameters</i> .....	6
3.5	DATA LOGGING FUNCTION.....	6
3.5.1	<i>In-/outputs</i> .....	6
3.5.2	<i>Data input / parameters</i> .....	6
3.6	ENERGY YIELD MEASUREMENT WITH GRUNDFOS SENSOR.....	6
3.6.1	<i>Data input / parameters</i> .....	7
3.7	MULTI-FUNCTION REGULATOR.....	7
3.8	HEATING.....	8
3.8.1	<i>In/outputs</i> .....	9
3.8.2	<i>Data input / parameters</i> .....	9
3.9	COOLING .....	9
3.9.1	<i>In/outputs</i> .....	9
3.9.2	<i>Data input / parameters</i> .....	9
3.10	THRESHOLD SWITCH.....	9
3.10.1	<i>In/outputs</i> .....	9
3.10.2	<i>Data input / parameters</i> .....	10
3.11	INCREASED RETURN FLOW .....	10
3.11.1	<i>In-/outputs</i> .....	10
3.11.2	<i>Data input / parameters</i> .....	10
3.12	WOOD BOILER.....	11
3.12.1	<i>In/outputs</i> .....	11
3.12.2	<i>Data input / parameters</i> .....	11
3.13	DIFFERENCE REGULATOR .....	11
3.13.1	<i>In/outputs</i> .....	11
3.13.2	<i>Data input / parameters</i> .....	11
3.14	TYPE 1 CIRCULATION FUNCTION: TIME-CONTROLLED .....	12
3.14.1	<i>In/outputs</i> .....	12
3.14.2	<i>Data input / parameters</i> .....	12
3.15	TYPE 2 CIRCULATION FUNCTION: TIME-AND TEMPERATURE-CONTROLLED .....	12
3.15.1	<i>In/outputs</i> .....	12
3.15.2	<i>Data input / parameters</i> .....	12
3.16	ALARM.....	13
3.16.1	<i>In/outputs</i> .....	13
3.16.2	<i>Data input / parameters</i> .....	13
3.17	TIMER.....	13
3.17.1	<i>In/outputs</i> .....	13
3.17.2	<i>Data input / parameters</i> .....	13
<b>4</b>	<b>SOLAR CIRCUIT CONTROL FUNCTIONS</b> .....	<b>14</b>
4.1	TYPES OF STORAGE TANK CHARGING .....	14
4.1.1	<i>Constant temperature difference</i> .....	14

4.1.2	Parallel charging .....	14
4.1.3	Intelligent priority switching .....	14
4.2	TYPE 1 TUBE COLLECTOR FUNCTIONS: TIME-CONTROLLED.....	15
4.2.1	In/outputs.....	15
4.2.2	Data input / parameters.....	15
4.3	TYPE 2 TUBE COLLECTOR FUNCTIONS: TEMPERATURE INCREASE DETECTION.....	15
4.3.1	In/outputs.....	15
4.3.2	Data input / parameters.....	15
<b>5</b>	<b>SPECIAL HEATING CIRCUIT FUNCTION.....</b>	<b>16</b>
5.1	WEATHER-CONTROLLED HEATING CIRCUIT.....	16
5.2	BASIC CHARACTERISTICS (SYSTEM-DEPENDENT): .....	16
5.3	HEATING CURVE DESCRIPTION .....	17
5.4	HEATING CIRCUIT MIXER .....	18
5.4.1	In/outputs.....	19
5.4.2	Data input / parameters.....	19
5.5	OUTDOOR TEMPERATURE .....	19
5.5.1	In/outputs.....	19
5.5.2	Data input / parameters.....	19
5.6	ROOM THERMOSTAT DESCRIPTION .....	20
5.6.1	Permanent setback  .....	20
5.6.2	Automatic with time frame  .....	20
5.6.3	Permanent operation without setback  .....	20
5.6.4	Offset repositioning  .....	20
5.6.5	In/outputs.....	20
5.6.6	Data input / parameters.....	20
5.7	HEATING CIRCUIT WITHOUT HOT WATER SUPPLY .....	21
5.7.1	In/outputs.....	21
5.7.2	Data input / parameters.....	21
5.8	HEATING CIRCUIT WITH WATER HEATING .....	22
5.8.1	In/outputs.....	22
5.8.2	Data input / parameters.....	22

## 1 General / Introduction

The REGTRONIC PM system control unit is compatible with a large number of systems.

Systems are either pre-programmed at the factory or can be initialised by customers.

The system deployed is dependent on the hydraulic layout of the system and any ancillary features required.

Generally, the individual functions of a system are independent of the basic layout selected. This document therefore describes them in terms of their general functionality.

This document defines the individual functions available with the REGTRONIC PM.

Apart from the various solar system models, there are a number of ancillary/protective features that are partially or completely integrated into the systems. The scope of these integrated functions can be identified by reading the system layout descriptions.

## 2 General principles:

As a rule, the system is regulated to the nearest full °C, i.e. 65.0 °C to 65.9 °C would be evaluated as 65 °C. Exceptions here include the tube collector function with delta-T criterion. This must be regulated to 1/10 °C.

The following applies when defining switch-on and switch-off points:

as temperatures measured approach a lower threshold value of xxx °C, switching occurs once the threshold value is exceeded, i.e. xxx – 0.1 °C.

Example: threshold value 40 °C, switching occurs at 39.9 °C. As temperatures measured approach an upper threshold value of xxx °C, switching occurs

when the threshold is reached, i.e. xxx °C. Example : threshold value 40 °C, switching occurs at 40.0 °C.

Where functions are bound to a fixed temperature value – such as the charging of storage tanks to TStmax or the system protection function – switch-on/switch-off occurs once the temperature value has been reached, and switch-off/switch-on once the temperature drops below the temperature value – 1 K (hysteresis).

Example: TStmax = 65 °C. Charging switches off at 65.0 °C and switches on once temperature drops below TStmax – 1K, i.e. 63.9 °C.

## 3 General control functions

The following describes general control functions that are implemented in addition to basic functionality in all hydraulic layouts.

The functions are configured using the "System Settings" menu.

### 3.1 Collector protection function

The collector protection function works to protect the collector and heat transfer media from high temperatures to the greatest possible extent.

The function is activated or deactivated in the "System Settings" menu. Start and stop temperatures can be configured.

If all storage tanks are charged to Tmax, then the solar circuit pump is switched off. Once the collector temperature reaches the configured start temperature, the solar circuit pump is started, and runs until the collector temperature has dropped to the configured stop temperature. A portion of the energy is lost via the tube lines; the remainder is released into the configured primary storage tank. This leads to an increase of the storage temperature above the configured maximum temperature. For safety reasons, the function is deactivated once the storage tank reaches 95 °C = TStLimit.

#### 3.1.1 In/outputs

Measuring points	Outputs
Collector temperature(s) Storage tank temperature(s)	Solar circuit pump(s)

#### 3.1.2 Data input / parameters

The following terms and parameters are defined to this function:

	Term	Comment
Values displayed	Function active: Coll.Protect	
Programmable values	--	
System Settings	Coll.Protect On / off	
	Start	Start temperature

	Stop	Stop temperature
Internal parameters	--	

## 3.2 System protection function

Protects the system / tube insulation from high temperatures.

The function is activated or deactivated in the "System Settings" menu. The corresponding start and stop temperatures are configured in the same menu.

The solar circuit pump is switched off once the collector temperature reaches the configured start value. The solar circuit pump is enabled again once the collector temperature drops below the configured stop value.

The value input for the system protection start temperature must be at least 10 K higher than the collector protection start temperature (forced by software).

### 3.2.1 In/outputs

Measuring points	Outputs
Collector temperature(s)	Solar circuit pump

### 3.2.2 Data input / parameters

	Term	Comment
Values displayed	Function active: SysProtect	
Programmable values	--	
System Settings	System protection On / off	
	Start	Start temperature
	Stop	Stop temperature
Internal parameters	--	

## 3.3 Anti-freeze protection function

The function is activated or deactivated in the "System Settings" menu.

For systems that are operated without glycol (or with only small quantities), both the tubing and collector must be protected from freezing. To do so, the (temperature frost protection) sensor measures the temperature on an exposed surface – e.g. bare tube line leading to the collector. If the value measured is below the configured start temperature, the solar circuit pump starts and runs until the configured frost protection stop temperature is reached. The minimum run time for the pump is 5 minutes.

If the temperature of the primary storage tank drops below 5 °C, the function is deactivated for safety reasons.

### 3.3.1 In/outputs

Measuring points	Outputs
Frost protection temperature Storage tank temperature(s)	Solar circuit pump

### 3.3.2 Data input / parameters

	Term	Comment
Values displayed	Info: Frost protection Function active: FProtect	
Programmable values	--	
System Settings	Frost protection	

	On / off	
	Start	Start temperature
	Stop	Stop temperature
	Sensor	
Internal parameters	Minimum run time	
	Minimum storage tank temperature	

### 3.4 Pump protection function

If pumps or valves remain unused for long periods of time, they may seize up. To stop this occurring in actuators attached to the system, pump protection therefore triggers all outputs regularly for a brief period of time (at 00:00 each day).

#### 3.4.1 In/outputs

Measuring points	Outputs
None	All pumps and valves

#### 3.4.2 Data input / parameters

	Term	Comment
Values displayed	Function active: PProtect	
Programmable values	--	
System Settings	--	
Internal parameters	Interval time	
	Pump run time	

### 3.5 Data logging function

The data logging function can be used to store all readings, output states and errors to an external "SOLAREG DATASTICK" at regular, programmable intervals.

The function is activated automatically if a DataStick internally coded as "LOGGING" is inserted into the DataStick® interface on the REGTRONIC unit.

Once the function is active, both the sampling rate and the recording mode (simple/cyclical) can be configured.

#### 3.5.1 In-/outputs

Measuring points	Outputs
All	All

#### 3.5.2 Data input / parameters

	Term	Comment
Values displayed	Info: Data logging Xxx %	Storage used in %
Programmable values	Data logging	
	Interval	Interval in min
	Recording mode	Simple/cyclical
	Reset	On / off
System Settings	--	
Internal parameters	--	

### 3.6 Energy yield measurement with Grundfos sensor

This uses a Grundfos VFS 2-40 type sensor.

This sensor unit integrates through-flow measurement (measuring range 2-40 litres/minute) and a temperature gauge.

Both measurement values are available as analog signals with a measuring range of 0.5...3.5 V.

Reference values for yield measurement are the heat exchanger input temperature (PT-1000 sensor T2), plus the temperature and through-flow measured by the Grundfos sensor.

Aside from activating yield measurement, the following settings must be configured:

- Selecting the antifreeze compound
- Configuring the mixing ratios
- Selecting the reference sensor for the flow temperature. Preferably, the T2 temperature sensor at the heat exchanger input is to be configured.


### 3.6.1 Data input / parameters

	Term	Comment
Values displayed	Info:	
	Amount T-F	Flow temperature
	Amount T-R	Return flow temperature
	Amount (1/2/3) Date:	Total amount (for storage tank) Daily amount
	Solar circuit flow volume	l/min
Programmable values	--	
System Settings	Yield measurement On / off	
	Function	VFS (not selectable, just as info)
	Glycol type	Various
	Glycol	Glycol proportion in %
	T-Flow	T2 is a preset: any other sensor may also be used
Internal parameters	--	

### 3.7 Multi-function regulator

The multi-function regulator (MultiReg or MFR) permits the operator to carry out a variety of different functions at an assigned switched output on the control unit.

This option is the most versatile way to implement additional functionality for the unit as regards solar circuit and heating circuit control.

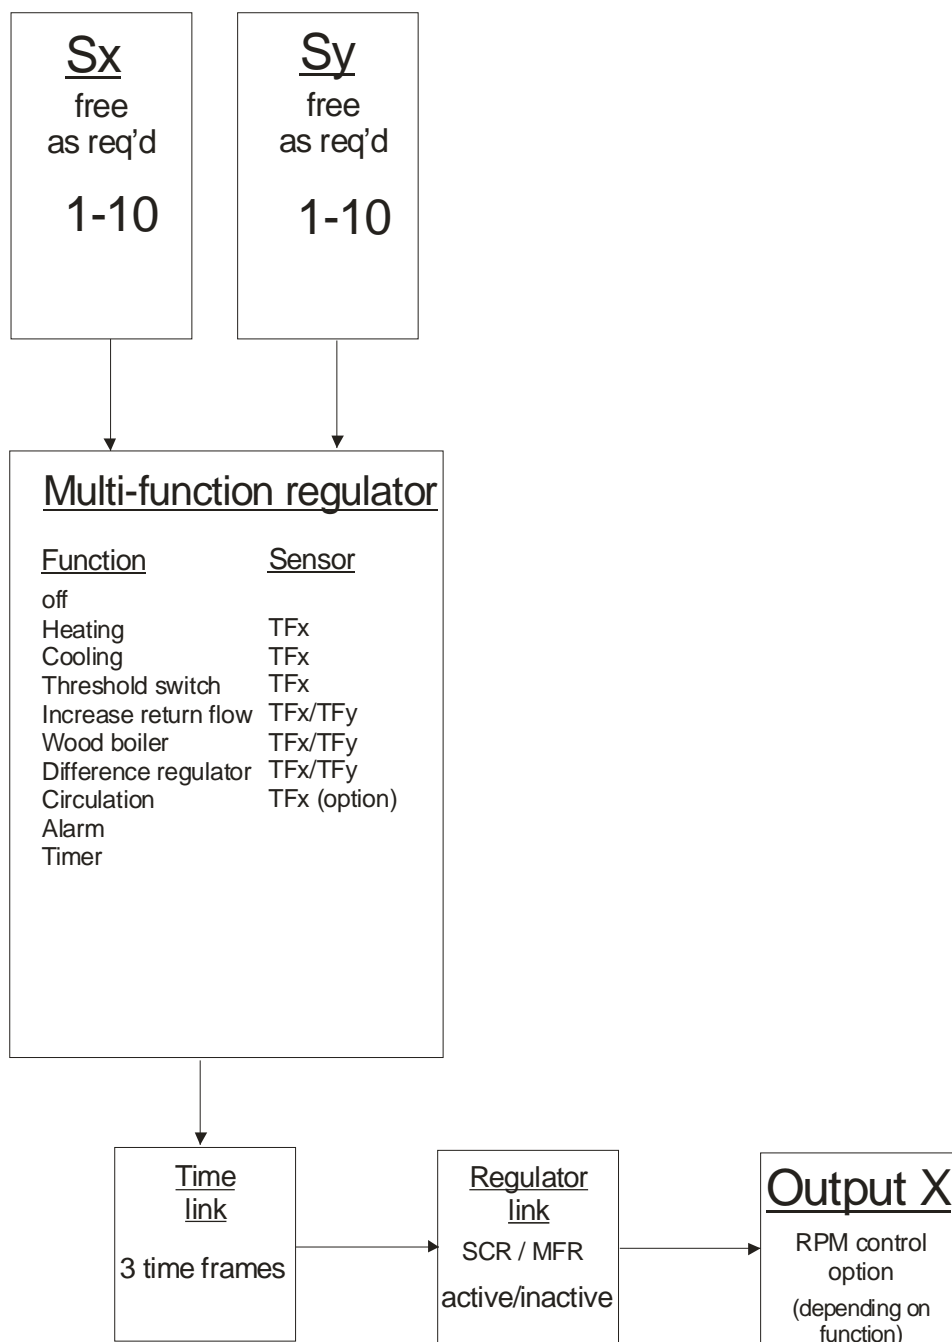

- Both inputs can be freely configured with sensors S1 - S10
- Functional variation by selecting the function required
- Control procedure can be executed within multiple time frames
- Optionally, the MFR can also be linked to other outputs – i.e. the status (none/active/inverse) of another output chosen by the user influences the control procedure of the current MFR
- RPM control option (depending on function)

The following describes the individual functions of the MFR:

### 3.8 Heating

The function is activated or deactivated as a multi-function regulator in the "System Settings" menu.

The thermostat function "Heating" is a control circuit independent of storage tank charging.

One use is therefore to reheat the upper stand-by section of the storage tank independently of the solar circuit function. This function can be run permanently or within programmable time frames.



### 3.8.1 In/outputs

Measuring points	Outputs
Upper storage tank temperature	Pump / valve reheating function

### 3.8.2 Data input / parameters

The following terms and parameters are defined to this function:

	Term	Comment
Values displayed	Info: Heating	
	Function active: Heating	
Programmable values	MultiReg: Heating	
	Time 1: Start	
	Time 1: Stop	
	Time 2: Start	
	Time 2: Stop	
	Time 3: Start	
	Time 3: Stop	
	Start	
Stop		
System Settings	MultiReg function: Heating	
Internal parameters	--	

## 3.9 Cooling

The function is activated or deactivated as a multi-function regulator in the "System Settings" menu. To increase the energy yield of the solar power system, it can be useful to "redirect" solar energy or release it from the storage tank once a specific storage temperature has been achieved.

### 3.9.1 In/outputs

Measuring points	Outputs
Upper storage tank temperature	Switched output for cooling (pump)

### 3.9.2 Data input / parameters

The following terms and parameters are defined to this function:

	Term	Comment
Values displayed	Info: Cooling	
	Function active: Cooling	
Programmable values	MultiReg: Cooling	
	Start	
	Stop	
System Settings	MultiReg function: Cooling	
Internal parameters	--	

## 3.10 Threshold switch

If a programmable value for the input temperature is exceeded, the output will be switched on or off. The switch-on/switch-off point and switch hysteresis are configured by entering a start and stop temperature. If the start temperature < stop temperature, the result is a heating function. If the start temperature > stop temperature, the result is a cooling function.

### 3.10.1 In/outputs

Measuring points	Outputs
1 temperature sensor, assigned as required	1 fixed output

### 3.10.2 Data input / parameters

	Term	Comment
Values displayed	Info: threshold value	
	Function active: threshold value	
Programmable values	MultiReg: threshold value	
	Start	Start temperature
	Stop	Stop temperature
	Time 1: Start	
	Time 1: Stop	
	Time 2: Start	
	Time 2: Stop	
System Settings	MultiReg function: Threshold	
	MultiReg Sensor	
Internal parameters	--	

## 3.11 Increased return flow

Increased return flow is a simple method to boost heating functionality, involving the release of energy from the solar circuit or storage tank into the heating return flow line. If the temperature of the heat source is higher than that of the sink + hysteresis, then the changeover valve (or pump) is activated.

### 3.11.1 In-/outputs

Measuring points	Outputs
Heat source	Changeover valve or pump
Heat sink (heating return flow)	

### 3.11.2 Data input / parameters

	Term	Comment
Values displayed	Info: Boost ret. flow ▲	
	Info: Boost ret. flow ▼	
	Status: Inc. r-flow.	
Programmable values	MultiReg: Boost ret. flow	
	maximum	Maximum temperature for heat target
	minimum	Minimum temperature for heat source
	dTmax	Increased return flow Switch-on difference (dT <sub>on</sub> )
	dTmin	Increased return flow Switch-off difference (dT <sub>off</sub> )
	Time 1: Start	
	Time 1: Stop	
System Settings	MultiReg function: Inc. r-flow	
	Source sensor ▲	
	Sink sensor ▼	
Internal parameters	--	

### 3.12 Wood boiler

Storage tank reheating using a solid fuel boiler. When combined with RPM control, a configurable minimum temperature for the boiler and a configurable temperature difference, there are a number of modes available for storage tank charging using solid fuel boilers.

Note: safety shut-off is triggered if  $T_{Storage} (T_{Sink}) \geq T_{StLimit}$  (usually 95 °C)!

#### 3.12.1 In/outputs

Measuring points	Outputs
Storage temperature (e.g. upper stand-by section) Boiler temperature	Boiler pump

#### 3.12.2 Data input / parameters

	Term	Comment
Values displayed	Info: Wood boiler▲	Boiler temperature
	Info: Wood boiler▼	Heating target
	Function active: Wood boiler	
Programmable values	MultiReg: Wood boiler	
	Start	Start temperature
	dTmax	
	minimum	
	Time 1: Start	
	Time 1: Stop	
	Time 2: Start	
	Time 2: Stop	
	Time 3: Start	
System Settings	MultiReg function: Wood boiler	
	Source sensor▲	
	Sink sensor▼	
Internal parameters	--	

### 3.13 Difference regulator

The temperature difference regulators can be configured as required in terms of inputs and parameters. The output assignments are fixed. Since minimum and maximum temperatures can be defined, these can be deployed universally – e.g. for transfer between storage tanks, etc.

#### 3.13.1 In/outputs

Measuring points	Outputs
2 temperature sensors, assigned as required	1 fixed output

#### 3.13.2 Data input / parameters

The following terms and parameters are defined to this function:

	Term	Comment
Values displayed	Info: Diff. regl.▲	
	Info: Diff. regl.▼	
	Function active: Diff. regl	
Programmable values	MultiReg: Diff. regl	
	maximum	Maximum sink temperature
	minimum	Minimum source temperature
	dTmax	
	dTmin	

	Time 1: Start	
	Time 1: Stop	
	Time 2: Start	
	Time 2: Stop	
	Time 3: Start	
	Time 3: Stop	
System Settings	MultiReg function: Diff. regl	
	Diff. regl Source sensor▲	
	Diff. regl Sink sensor▼	
Internal parameters	--	

### 3.14 Type 1 circulation function: time-controlled

A circulation function is used to make it easier to draw hot water from the system. This enables hot water to be drawn immediately.

The circulation pump is only active during the programmed time frame. The T criterion has no function here. Simple time control is activated by setting "Circulation Start" and "Circulation Stop" to the same temperature value. In this case, the screen will show "--°C".

#### 3.14.1 In/outputs

Measuring points	Outputs
None	Circulation pump

#### 3.14.2 Data input / parameters

	Term	Comment
Values displayed	Info: Circulation	
	Function active: Circulation	
Programmable values	MultiReg: Circulation	
	Time 1: Start	
	Time 1: Stop	
	Time 2: Start	
	Time 2: Stop	
	Time 3: Start	
	Time 3: Stop	
System Settings	MultiReg function: Circulation	
Internal parameters	--	

### 3.15 Type 2 circulation function: time-and temperature-controlled

A circulation function is used to make it easier to draw hot water from the system. This enables hot water to be drawn immediately.

The circulation pump is active during the programmed time frame only if the T criterion is also met.

#### 3.15.1 In/outputs

Measuring points	Outputs
Hot water return flow temperature	Circulation pump

#### 3.15.2 Data input / parameters

	Term	Comment
Values displayed	Info: Circulation	
	Function active: Circulation	
Programmable values	MultiReg: Circulation	

	Start	
	Stop	
	Time 1: Start	
	Time 1: Stop	
	Time 2: Start	
	Time 2: Stop	
	Time 3: Start	
	Time 3: Stop	
System Settings	MultiReg function: Circulation	
Internal parameters	--	

### 3.16 Alarm

The alarm function is activated or deactivated as an MFR in the "System Settings" menu. If the system under control triggers an error condition – e.g. sensor short-circuit or sensor disruption – and the alarm function is switched on, this activates the output of the corresponding multifunction regulator. If required, this signal can be detected and displayed by a building control system.

#### 3.16.1 In/outputs

Measuring points	Outputs
--	230 V output, e.g. for siren, strobe light

#### 3.16.2 Data input / parameters

	Term	Comment
Values displayed	Function active: Alarm	
Programmable values	MultiReg: Alarm	
	Signal	duration, interval
	Time 1: Start	
	Time 1: Stop	
	Time 2: Start	
	Time 2: Stop	
	Time 3: Start	
	Time 3: Stop	
System Settings	MultiReg function: Alarm	
Internal parameters	--	

### 3.17 Timer

The timer function can be used as required to provide time controlled releasing or locking of the output of the respective multi-function regulator. A total of three time frames are available for this control. The locked state can be viewed as an "inverse state" – i.e. the output of the MFR is inactive during the time frame and active outside it.

#### 3.17.1 In/outputs

Measuring points	Outputs
--	230 V output (selected as required)

#### 3.17.2 Data input / parameters

	Term	Comment
Values displayed	Function active: Timer	
Programmable values	Timer	
	Function	Release, lock
	Time 1: Start	
	Time 1: Stop	
	Time 2: Start	
	Time 2: Stop	
	Time 3: Start	

	Time 3: Stop	
System Settings	MultiReg function: Timer	
Internal parameters	--	

## 4 Solar circuit control functions

### 4.1 Types of storage tank charging

One or more storage tanks will always be charged if the collector or collector flow temperature is at least equal to the storage tank temperature – as measured at the level of the heat exchanger or tapping point (for exterior heat exchangers) – plus switch-on hysteresis.

There are a number of control types available, depending on the system:

- On/off controller (pump capacity 100%)
- Constant temperature difference (controlled pump capacity)
- Target temperature charging (controlled pump capacity)
- Parallel charging (controlled pump capacity)
- Intelligent priority switching

The various control types are virtually independent of the basic system type, and can thus be implemented in systems with one or multiple storage tanks.

#### 4.1.1 Constant temperature difference

Control is essentially the same as with an on/off controller. However, the system adjusts pump capacity with the aim of keeping the temperature difference between the collector and storage tank temperature to a constant value  $dT_{Target}$ . If the difference drops below this value, the pump runs at its lowest possible capacity until the difference drops below  $dT_{min}$ , at which point it switches off.

#### 4.1.2 Parallel charging

Where systems have more than one storage tank, two tanks can be charged simultaneously. Once the temperature difference between the collector and the primary storage tank reaches a certain (configurable) value, the system activates the pump of the secondary storage tank.

Parallel charging works only in systems with one charging pump per storage tank.

#### 4.1.3 Intelligent priority switching

Where systems have more than one storage tank, it must be possible to charge the various storage tanks to match the energy available. Generally, secondary storage tanks will have temperature levels significantly lower than the primary storage tank. If the system switches to a secondary tank, this will depress the temperature in the collector circuit: the system will be unable to return to the temperature level of the primary tank, even if solar radiation increases.

It is therefore normal to pause secondary tank charging briefly at set intervals, to ensure that the collector temperature can "regenerate" itself. If the collector temperature meets the switch-on criterion for the primary storage, then this tank is charged. Other criteria for pausing charging are a rise in collector temperature by a specific temperature value during secondary storage charging, as well as a drop in the primary storage temperature by a specific temperature value, also during secondary storage charging.

In bypass systems, primary storage tank charging can be triggered by the achievement of a specific flow temperature.

Priority switching can be configured in the "Programming" menu (visible if the system has at least 2 storage tanks).

## 4.2 Type 1 tube collector functions: time-controlled

With tube collectors, it is sometimes not possible to measure the precise collector temperature on or in the collector. Accordingly, other criteria must be applied for switching on the solar power system.

The solar circuit pump is switched on briefly at specific intervals, so that the heat transfer medium can reach the collector sensor, which is mounted as near as possible to the collector.

A time frame can be configured, setting the period in which the function is active. The time interval between two pump runs can also be configured, as can the pump run time.

### 4.2.1 In/outputs

Measuring points	Outputs
None	Solar circuit pump

### 4.2.2 Data input / parameters

	Term	Comment
Values displayed	Function active: tubes	
Programmable values	Tube collectors	
	Time 1: Start	
	Time 1: Stop	
System Settings	Tube collectors On / off	
	Function	Time
	Run time	Pump run time
	Interval	Time interval
Internal parameters	--	

## 4.3 Type 2 tube collector functions: temperature increase detection

If the collector sensor can be positioned very near to the collecting tube, then it will not show the actual collector temperature, but will be warmed by heat conduction. The control unit detects and evaluates this rise in temperature. The solar circuit pump is then switched on for a (configurable) minimum run time.

### 4.3.1 In/outputs

Measuring points	Outputs
Collector flow temperature	Solar circuit pump

### 4.3.2 Data input / parameters

	Term	Comment
Values displayed	Function active: tubes	
Programmable values	--	
System Settings	Tube collectors On / off	
	Function	delta T
	Run time	Pump run time
	delta T	Absolute increase in collector temperature, as measured from last pump run time
Internal parameters	--	

## 5 Special heating circuit function

### 5.1 Weather-controlled heating circuit

The mixer control system is used to control a heating circuit. The actual temperature for the heating flow is kept constant using the mixer. The target temperature depends on the outdoor temperature and, optionally, on a secondary room temperature sensor. The heating curve may equal a straight line (two reference points) or a set of characteristic curves.

### 5.2 Basic characteristics (system-dependent):


- Weekly program with 4 time frames for daily setback operation (basic configuration via the "Master Day")
- Room thermostat can also be used
- Offset configuration (straight line or characteristic curve displacement)
- Heating curve can be set to straight line or characteristic curve (gradient)
- Configuration of minimum and maximum flow temperature
- Parametric adjustment of control system for a variety of mixes
- Holiday mode (permanent setback for a specified number of days)
- Various operating modes for the heating system:
  - Heating circuit "Off"
  - Heating circuit "Permanent"
  - Heating circuit "Automatic" (weekly plan for setback)
  - Heating circuit "Summer" (with anti-freeze protection function)
  - Heating circuit "Party" (deactivates nightly setback for specified duration)
  - Heating circuit "Emission" (boiler inspection programme)

And for water heating:

- Water heating "Off"
- Water heating "Auto"
- Water heating "Auto-Time"
- Selectable water heating priority
- Heating circuit switch-off dependent on outdoor temperature
- Configurable staged smoothing of outdoor temperature:
  - Light (smoothing period 3 h)
  - Medium (smoothing period 24 h)
  - Heavy (smoothing period 48 h)
- Reduced pump RPM possible during setback
- Operation with room thermostat




### 5.3 Heating curve description

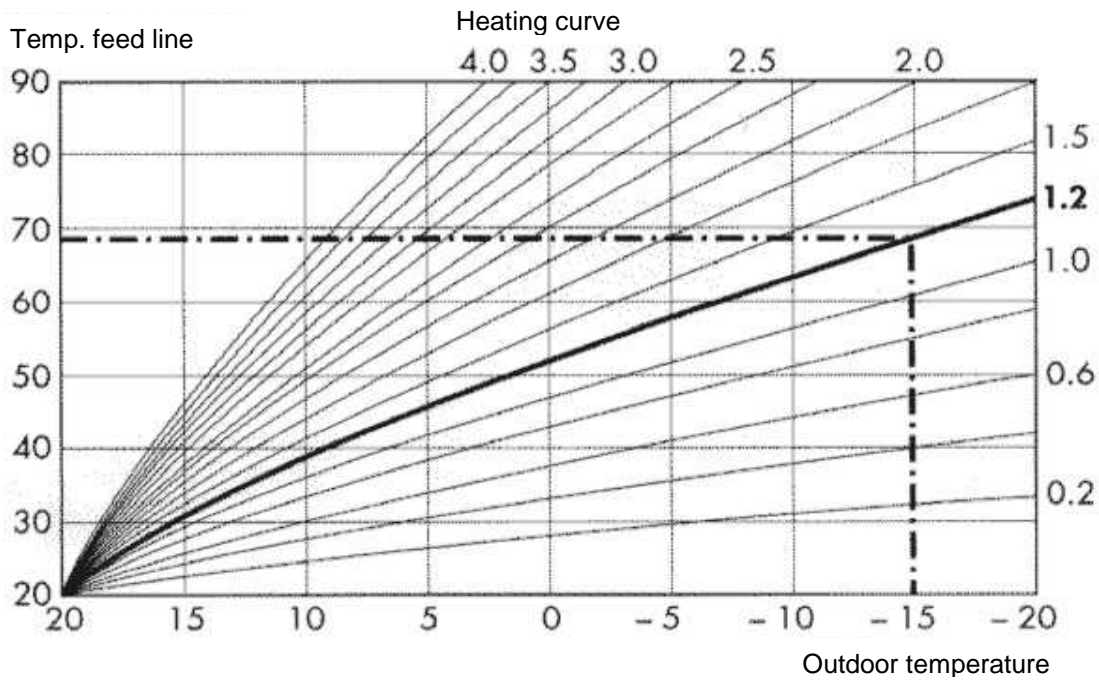


In the diagram, the "HK1.2" curve type has been selected. This means that if the desired room temperature is 20 °C and the outdoor temperature is -15 °C, then the flow temperature must be about 70 °C.

To simplify matters, a straight line may be used as the heating curve instead of selecting a curve from a set of characteristic curves.

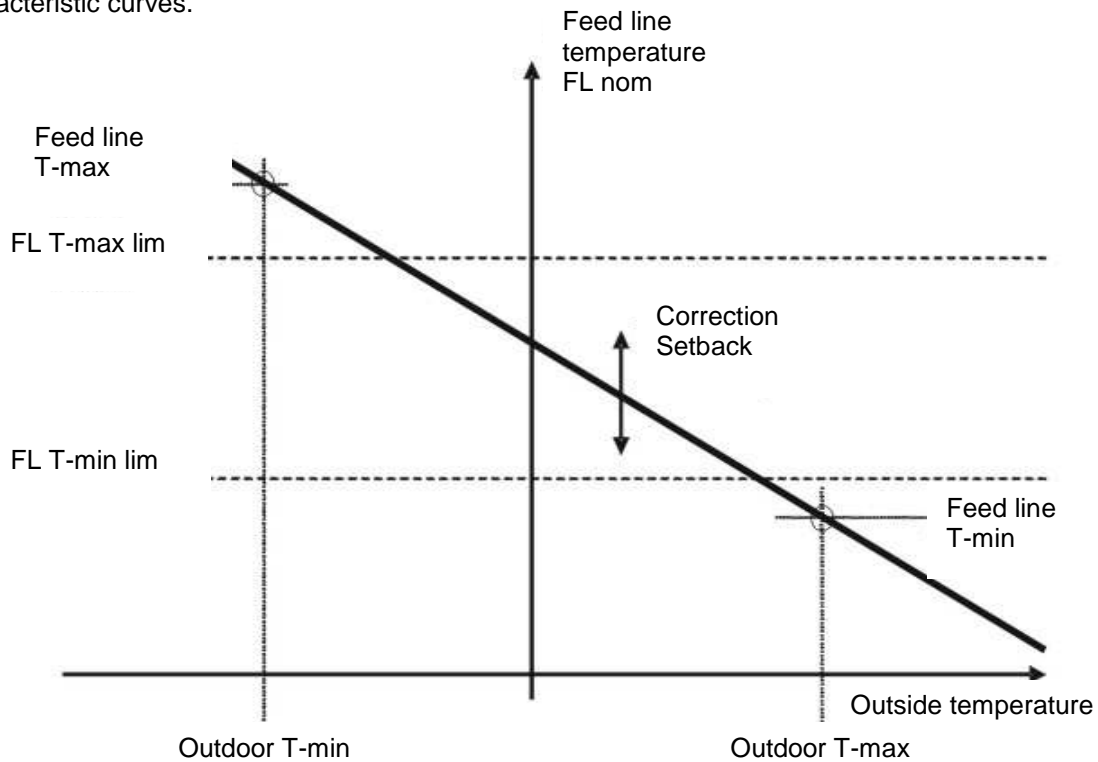


The straight-line (in the diagram, the **thick** line) that defines the heating curve is defined with two reference points. The first point is defined by the parameters "Flow Tmax" and "Outdoor Tmin", the second by "Flow Tmin" and "Outdoor Tmax". The absolute limits for the complete heating curve (incl. setback and correction, etc.) are defined by the configurable parameters "FL T-min Limit" and "FL T-max Limit". By configuring offset values, such as corrections and setback, the heating curve can be set to a parallel position higher or lower on the axis "Heating FL Target". The value "Heating FL Target" is calculated from the line of the heating curve, taking into account the outdoor temperature and the configured outflow temperatures.

**Outdoor temperature control for the heating circuit:**

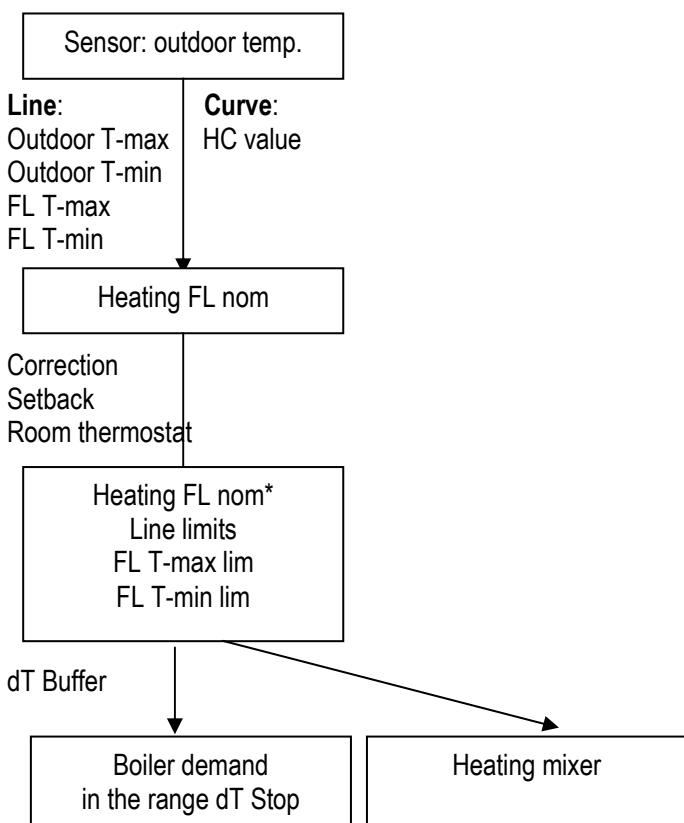

**Brief explanation:**


- Outdoor temperature reading
- Calculation of Heating FL Target via heating curve
- Correction of heating curve → Heating FL Target \*
- Range constraint
- Boiler demand or mixer control

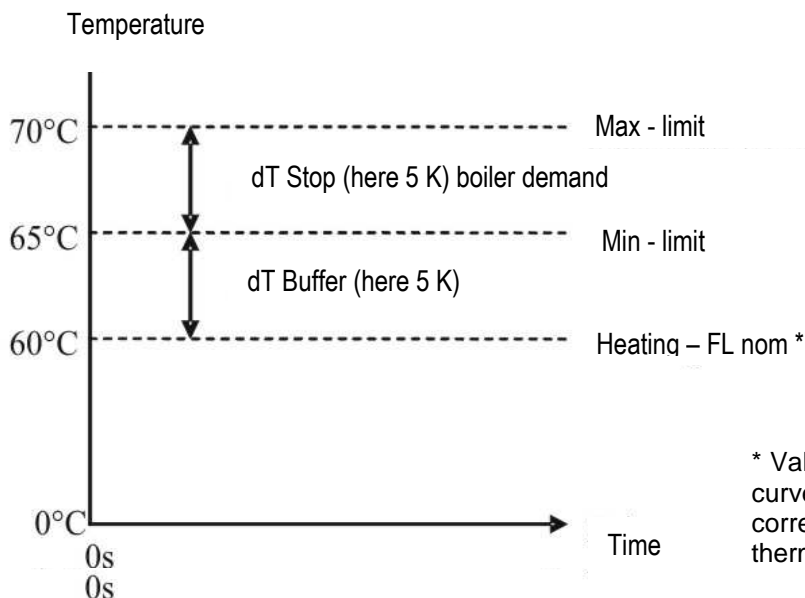

\* Value calculated from the heating curve, taking into account correction, setback and room thermostat

## 5.4 Heating circuit mixer

Options for the heating circuit mixer can be configured in the "System Settings" menu.

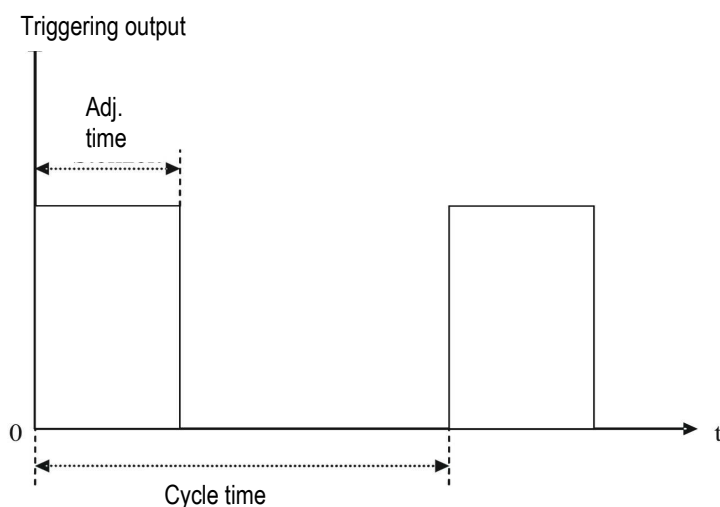

$$\text{Adj. time} = \text{Total run time} / \text{Resolution for stages}$$

### 5.4.1 In-/outputs

Measuring points	Outputs
--	--

### 5.4.2 Data input / parameters

	Term	Comment
Values displayed	Function active: current status	Mixer on, off, control
Programmable values	--	
System Settings	Heat. circ. mixer Total run time	Total run time
	Heat. circ. mixer Interval	
	Heat. circ. mixer Resol. stage	Resolution for stages
Internal parameters	--	

## 5.5 Outdoor temperature


### 5.5.1 In-/outputs

Measuring points	Outputs
Exterior temperature sensor	--

### 5.5.2 Data input / parameters

	Term	Comment
Values displayed	Function active: current status	Mixer on, off, control
Programmable values	--	
System Settings	Outdoor temp. HC switch-off	
	Outdoor temp. Smoothing	light, medium, heavy
Internal parameters	--	

## 5.6 Room thermostat description

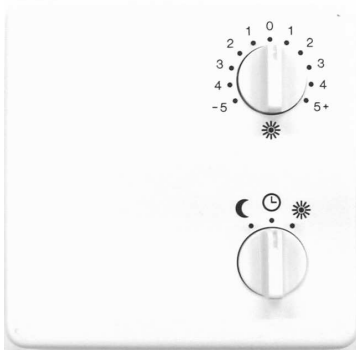

### 5.6.1 Permanent setback

If the lower rotary knob is set to "Moon", then the control circuit switches to the preset permanent setback mode.

### 5.6.2 Automatic with time frame

"Clock" setting: automated heating circuit control, within the set time frame and according to the programmed weekly schedule.

### 5.6.3 Permanent operation without setback

If the heating circuit is set to "Sun", then the heating circuit will run permanently. Any time frames for the weekly schedule, nightly setback, etc., will not be used. No setback to the "Heating FL Target" temperature will occur.

### 5.6.4 Offset repositioning

The upper rotary knob can be used to raise or lower the "Heating FL Target" value manually by +10 K or -10 K. This "offset repositioning" is then included in calculations involving corrections/setback. The value next to the rotary knob must be multiplied by a factor of 2.

### 5.6.5 In-/outputs

Measuring points	Outputs
Room thermostat	Any free input

### 5.6.6 Data input / parameters

	Term	Comment
Values displayed	Info:	
	Room thermostat Perm. setback	
	Room thermostat Automatic	
	Room thermostat Perm. operation	
	Room thermostat Parallel repos.	-10 K to +10 K
Programmable values	--	
System Settings	Room thermostat on / off	
	Room thermostat sensor	
Internal parameters	--	

## 5.7 Heating circuit without hot water supply

### 5.7.1 In/outputs

Measuring points	Outputs
Outdoor temperature	Heating circuit pump
Room temperature (optional)	Mixer On
Heating circuit flow temperature	Mixer Off
Storage tank (centre)	Boiler release (optional)

### 5.7.2 Data input / parameters

	Term	Comment
Values displayed	Info: Storage tank →	Storage tank temp. (centre) (Sensor for heating circuit feed-in)
	Info: Heating FL	Temp. heating flow
	Info: Heating FL Target	Temp. heating flow target
	Info: Room thermostat parallel repos.	
	Info: Outdoor	Outdoor temperature
	Function active: current status	Heating, Mixer On, Mixer Off, Mixer Control, Emission, Boiler Demand
Programmable values	Heating Mode	Off, Permanent, Auto, Summer, Party, Emission
	Heating Weekly schedule	Monday to Sunday or "Master Day"
	Heating Holiday setback	
	Heating Correction	
	Heating Setback RPM	
	Heating Permanent setback	
System Settings	Heating curve: Type: Gradient / straight	
	Heating curve: slope	HC 0.4 – HC 4.5 (only if HC type "gradient")
	Heating curve Outdoor T-min	Only if HC type "gradient"
	Heating curve Flow T-min	Only if HC type "gradient"
	Heating curve Outdoor T-max	Only if HC type "gradient"
	Heating curve Flow T-max	Only if HC type "gradient"
	Heating curve FL T-max Limit	
	Heating curve FL T-min Limit	
	Heating curve dT Buffer	1 K-20 K
	Heating curve dT Stop	Boiler demand 1 K-20 K
	Room thermostat: Sensor	Select TS

#### Glossary/explanations

##### a) Heating mode:

- Permanent: HC always active
- Auto: HC active during configured time frame
- Summer: HC permanent setback with anti-freeze protection function
- Party: Next time frame is skipped
- Emission: HC is switched off for 25 min., to permit boiler inspection work

##### b) Heating curve holiday setback:

- HC mode set to permanent setback mode (plus anti-freeze protection function) for the configured holiday period

##### c) Heating curve:

- "Outdoor T-min", "Outdoor T-max", "Flow T-min", "Flow T-max" configure the line of the heating curve
- The "Heating FL Target" value follows the heating curve within the area defined by "FL T-max limit" and "FL T-min limit"
- Boiler demand is active within the range "dT Stop"
- "dT Buffer" is an offset repositioning for boiler demand

## 5.8 Heating circuit with water heating

### 5.8.1 In-/outputs

Only the in-/outputs for water heating are available here. If a heating circuit should also be available, then the in-/outputs from 6.1.1.1 will also be required.

Measuring points	Outputs
Upper storage tank temperature	Water heating pump

### 5.8.2 Data input / parameters

For water heating, the parameters given in the table will be required in addition to the heating circuit parameters.

	Term	Comment
Values displayed	Info: Storage tank ↑	Storage tank temp. (upper)
Programmable values	Water heating mode	Off, Auto, Auto-Time
	Water heating priority	Off, On
	Water heating start	
	Water heating stop	
	Water heating Time1: Start	
	Water heating Time1: Stop	
	Water heating Time2: Start	
	Water heating Time2: Stop	
	Water heating Time3: Start	
	Water heating Time3: Stop	
System Settings	Water heating on / off	
Internal parameters	--	